




Avalon Ft Greene

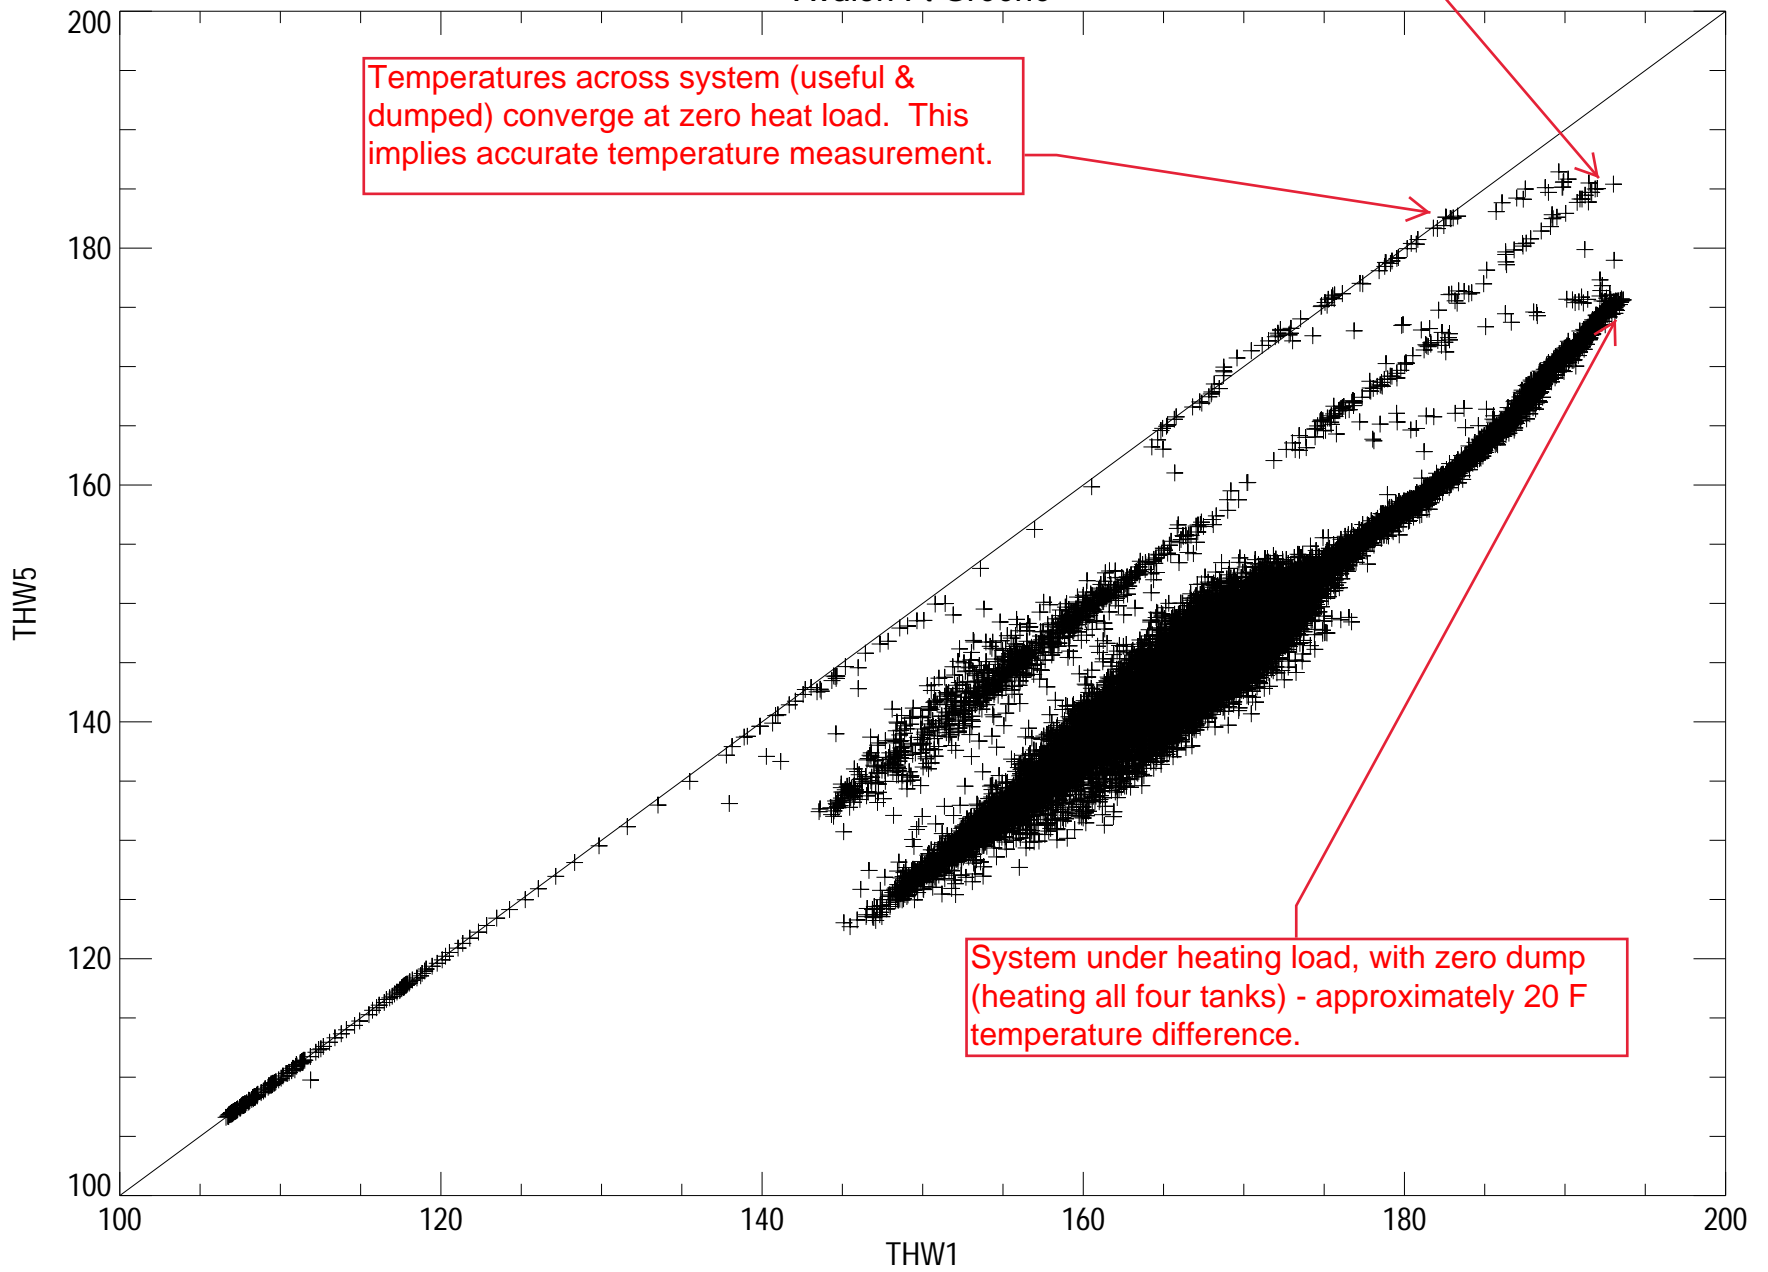

Avalon Fort Greene FCE elec vs Rating

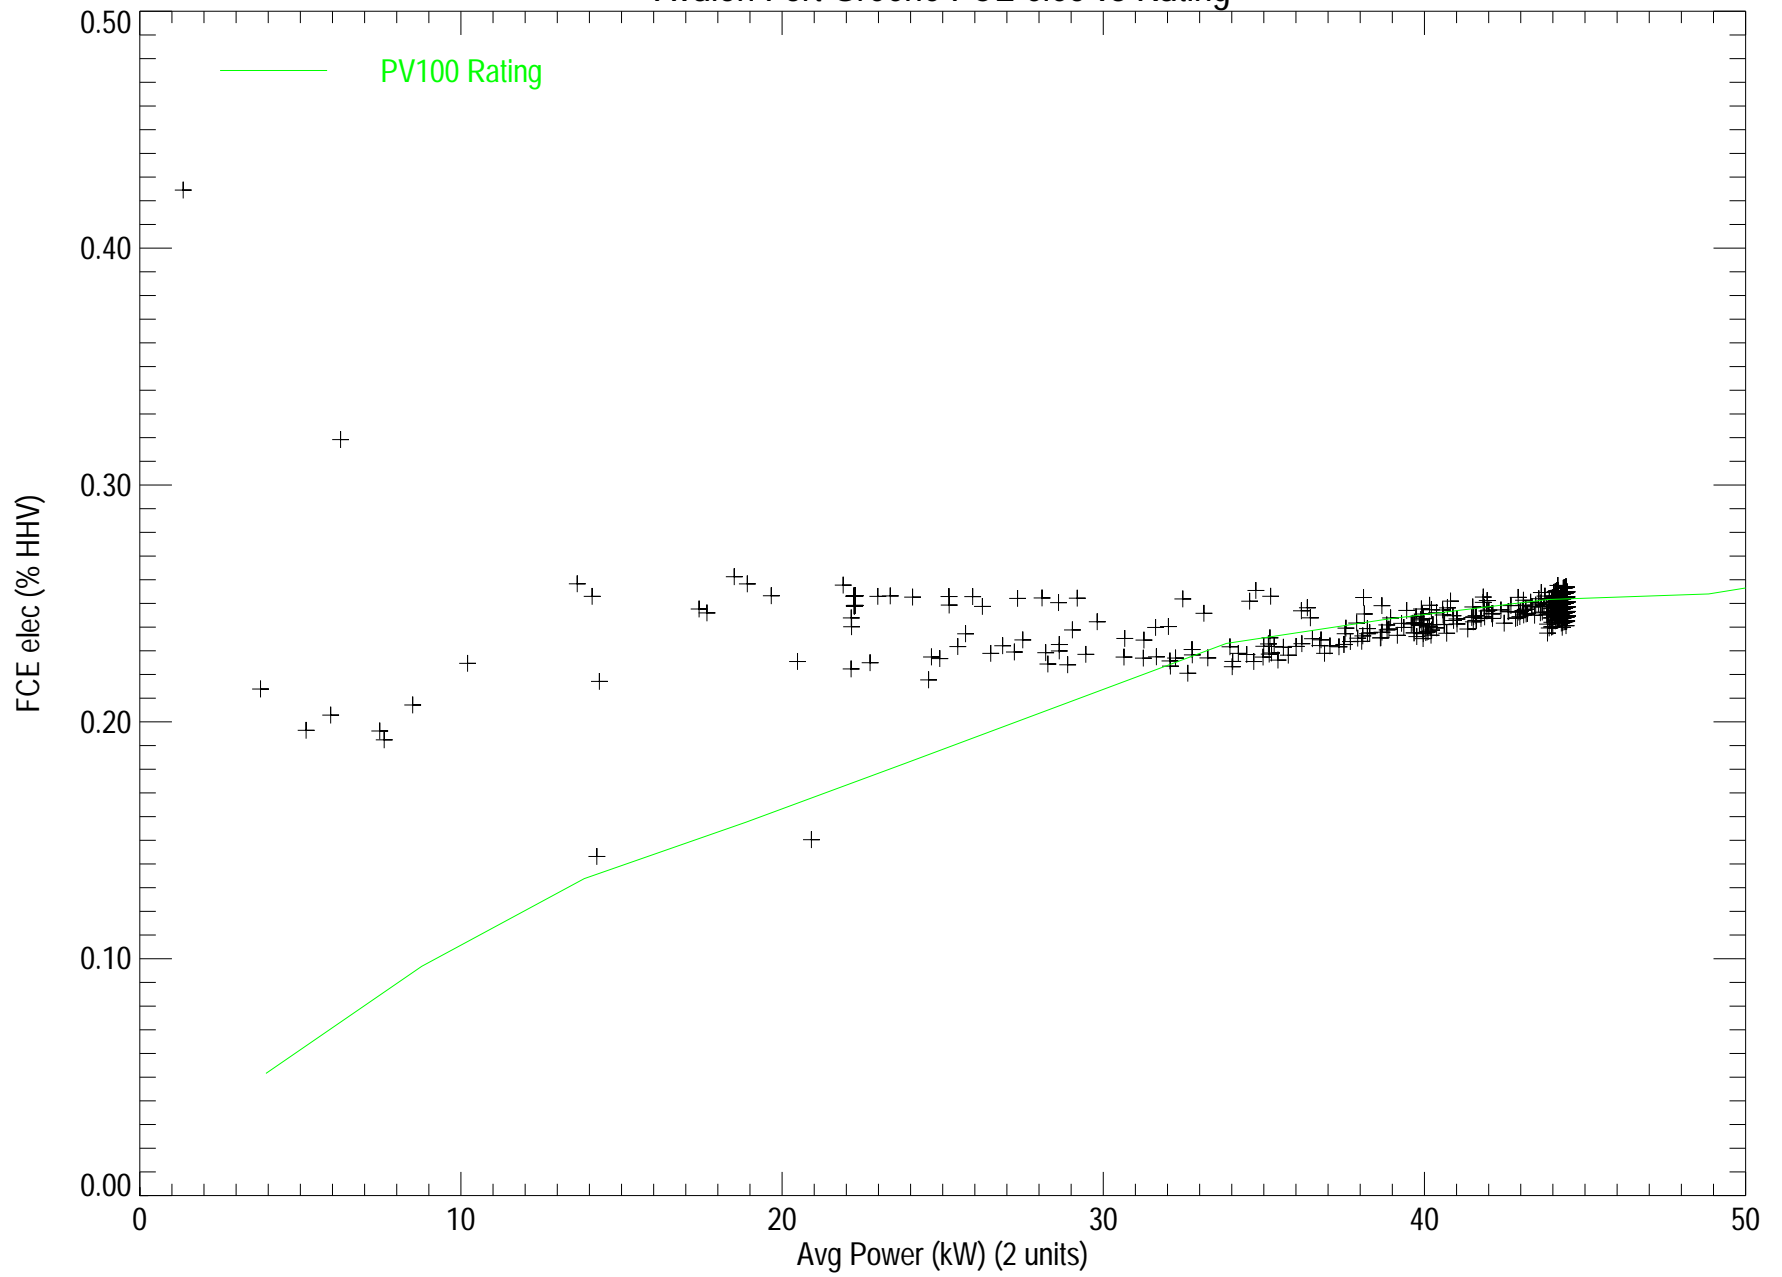


Avalon Fort Greene Total Energy Balance vs Rating

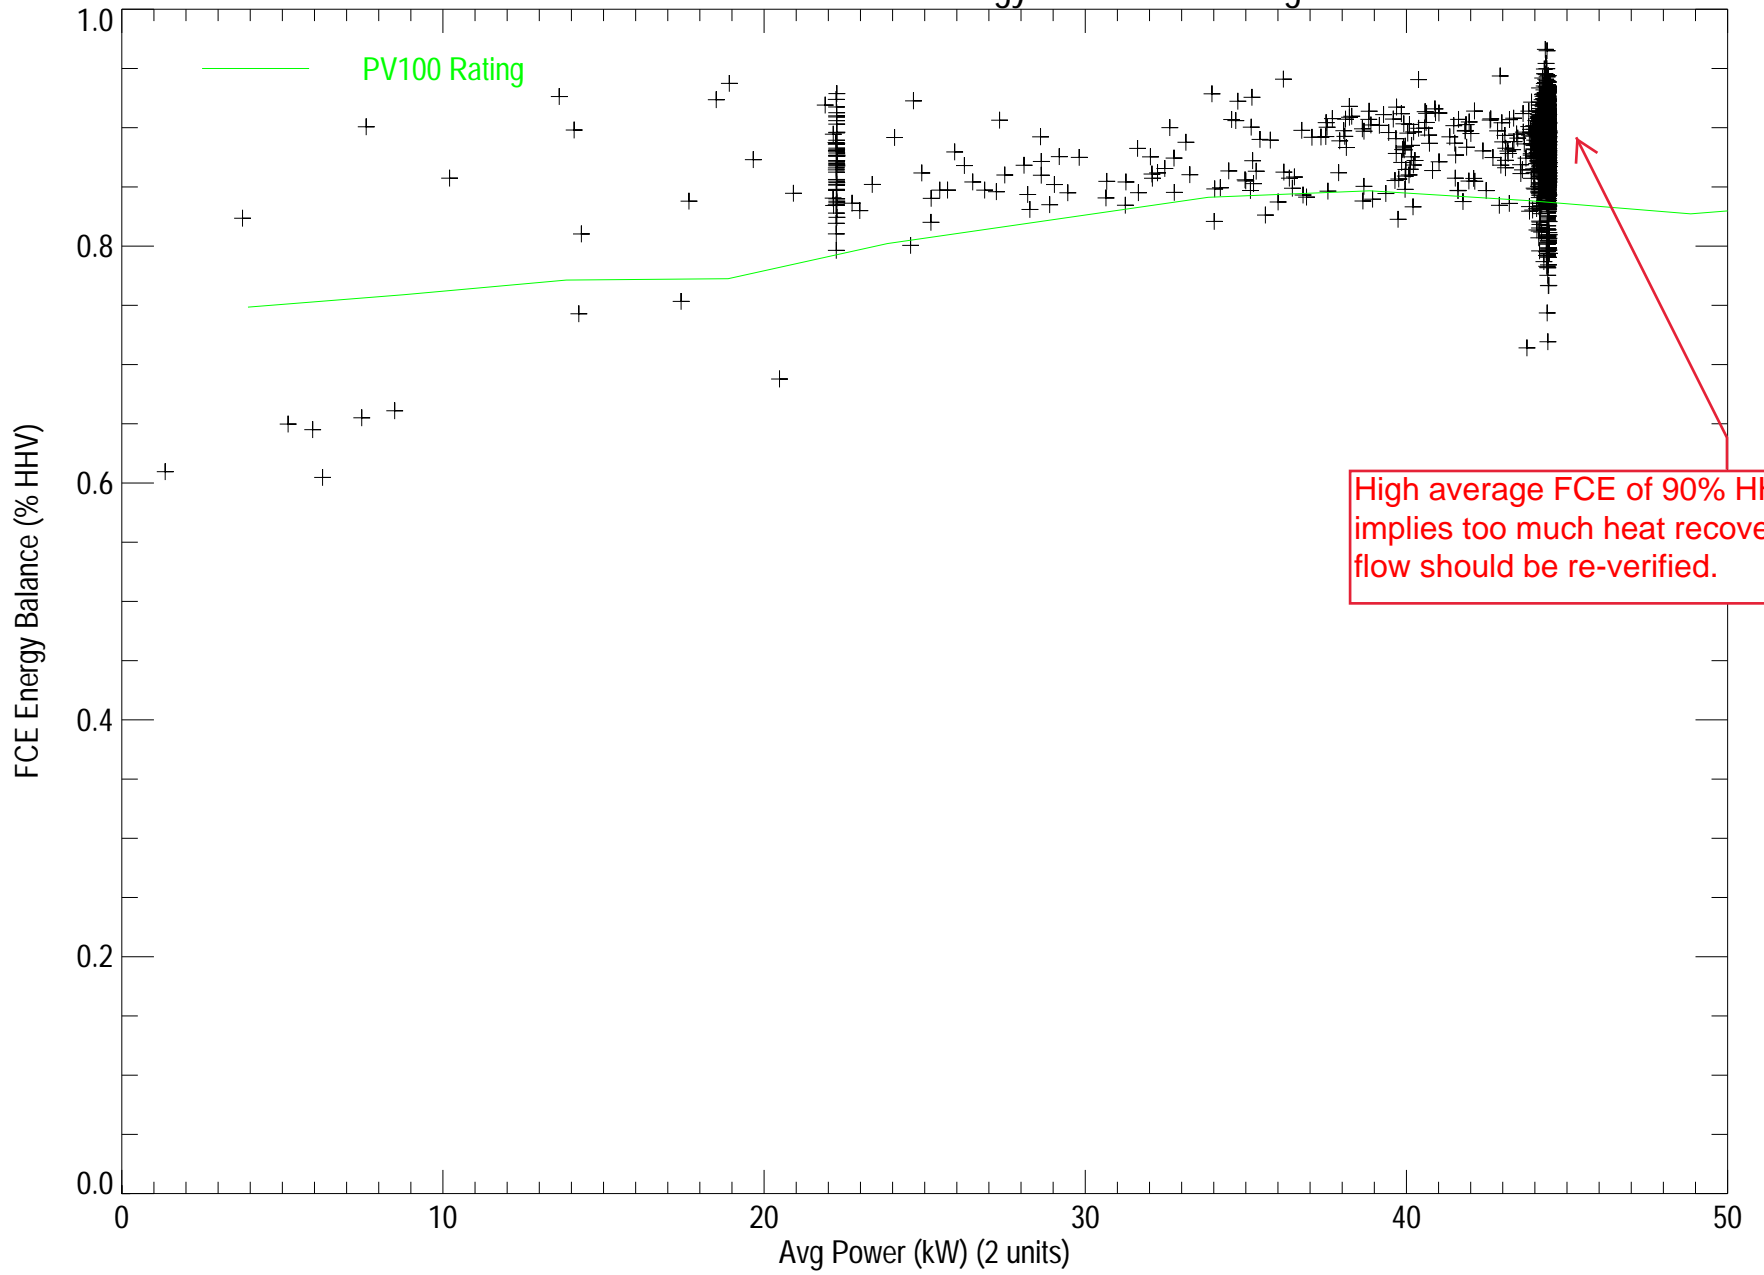

High average FCE of 90% HHV implies too much heat recovery - flow should be re-verified.

Avalon Fort Greene Total Heat Output vs Rating

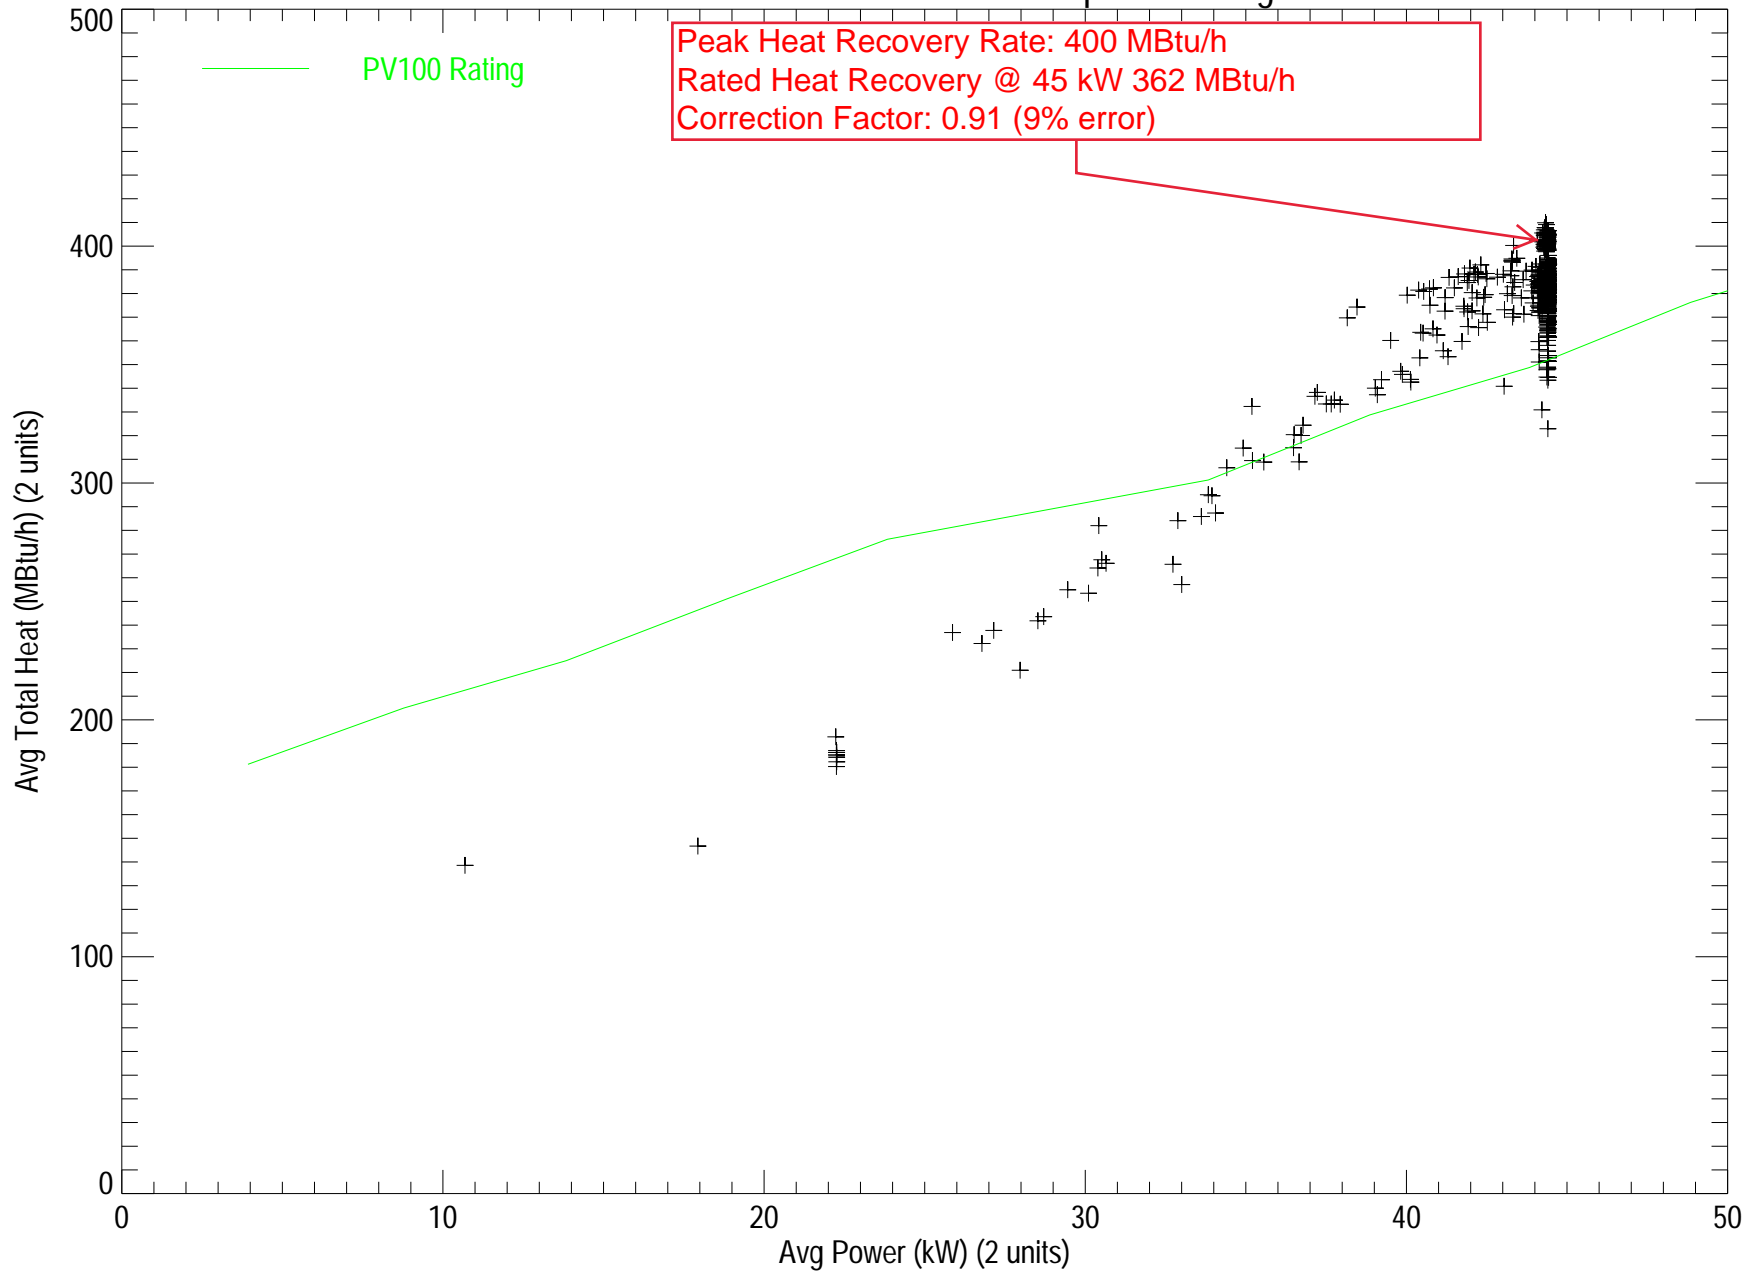

Avalon Fort Greene Total Energy Balance vs Rating

